



Engineered Solutions



HVAC Restoration & Installation of Q-PAC Fan Array at an Orlando, FL Children's Hospital



AHU Before



Old Blower Removal



Old VFD Blower Motor Removal

Authorized Reseller:



Sonny Mouton
(337) 367-3547

SMouton@AcadianaFilters.com
2505 Jane St., New Iberia, LA 70563



Old Blower Wheel Removed





Old Blower Housing Disassembled



AHU Interior Prep



Q-PAC Fan Wall Installation



Q-PAC Fan Wall Installation



Q-PAC Fan Installation




Q-PAC Fan Installation



Interior Plenum After Pure-Coat



Drain Pan After Pure-Liner^{2.0}

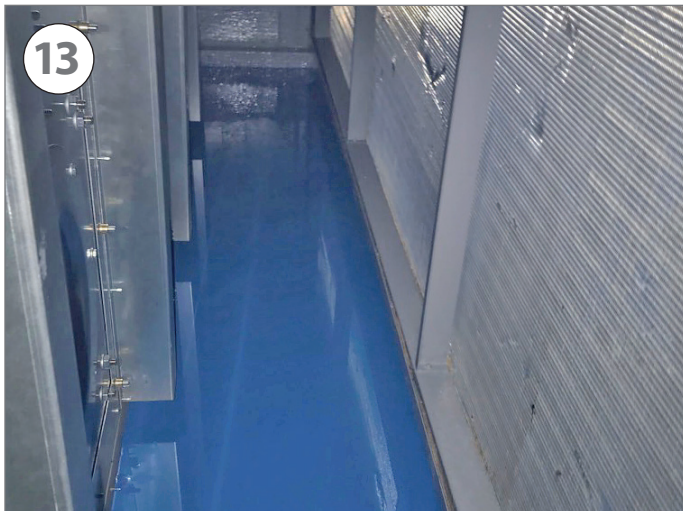

Drain Pan After Pure-Liner^{2.0}



Pure-Cell Installation




Pure-Cell Installation



Pure-Cell Installation



Pure-Cell With Fans

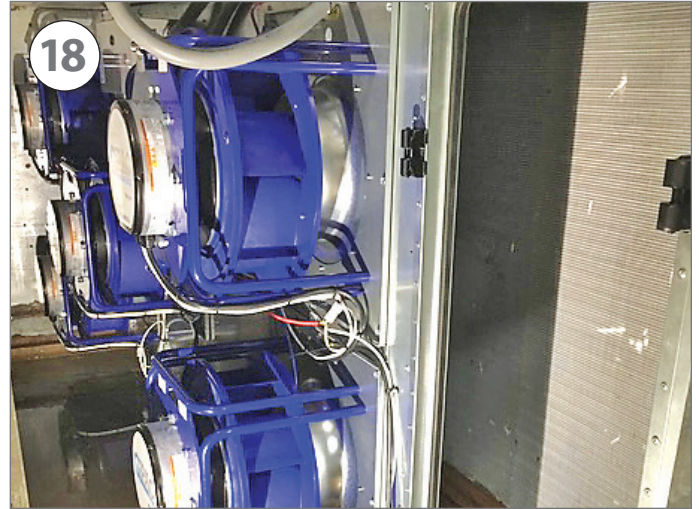

Q-PAC Fan Array Installed



AHU After



AHU After



With



Authorized Reseller:



Sonny Mouton
(337) 367-3547

SMouton@AcadianaFilters.com
2505 Jane St., New Iberia, LA 70563

Case Study:



20% COST OF NEW

It was estimated a replacement of 5 AHUs would have cost \$1.9 million dollars, including ACHA compliance, engineering, spot cooling and facility downtime. HVAC New Life with Q-PAC fan arrays effectively restored the units to better than new condition for a little over \$400,000, with little to no disruption in the facility.



PURE AIR CONTROL SERVICES
Corporate Headquarters
pureaircontrols.com
4911 Creekside Dr., Ste. C
Clearwater, FL 33760